


(F)19 Rim Device

Rim Panic and Fire Exit Device, Metal Door, LHR Shown, RHR Opposite

- For device with trim, refer to trim template.
- For exit only device drill $\frac{9}{32}$ " (7 mm) dia. hole through, then drill $\frac{3}{8}$ " (10 mm) dia. hole on opposite side of door for sexbolts (2 holes).

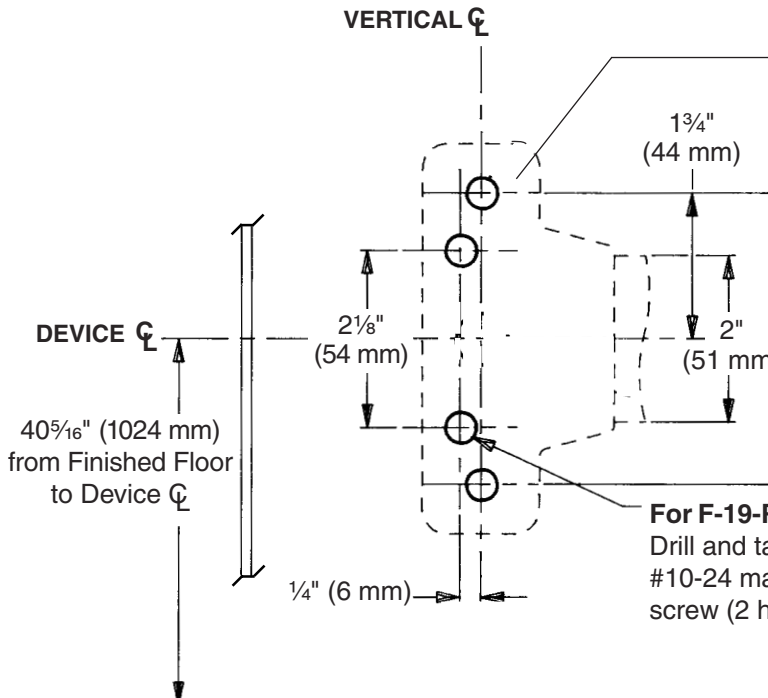

- For sexbolt preparation, refer to Template T-4014.
- For outside trim, see trim template for door preparation.

DOUBLE DOOR APPLICATION

Strike	Installed With	Min. Stile	B
565	2923 Mullion	3 1/8"	2 3/16"
565	4023 Mullion	3 3/8"	2 7/16"
570	2923 Mullion	3 1/2"	2 3/8"
570	4023 Mullion	3 3/4"	2 5/8"
F-570	F-4023 Mullion	3 3/4"	2 5/8"
F-490	F-4023 Mullion	3 3/4"	2 5/8"
571	19 Vertical	3 1/4"	2 5/16"
571-A	19 Vertical	2 3/4"	1 13/16"

* Covers ANSI A115.2 stock prep when used with a 5/8" stop height.

SINGLE DOOR APPLICATION

Strike	Installed	Min. Stile	A
565	Surface	2 7/8"	1 7/16"
565	Flush	1 3/4"	1 5/16"
570*	Surface	3 1/2"	1 5/8"
F-570*	Surface	3 1/2"	1 5/8"
F-490*	Surface	3 1/2"	1 5/8"

Note: 571 and 571-A strikes are not approved for fire rated applications.

TEMPLATE
T-1100-b